

The Opposed Piston Differential

Pressure Switch is essentially two Static "O" Ring

type pressure sensors connected at opposite ends of a common piston shaft. Housings are weathertight or explosion proof. Switching elements are SPDT or DPDT. See Principles of Operation on page 2.

Application Information


Opposed piston differential pressure switches in this catalog are suitable for a variety of process and fluid power applications. Basic models with standard wetted parts are normally suitable for air, oil, water and noncorrosive process fluids. See the Quick Selection Guide on page 3.

Certain corrosive applications and specific user requirements may require customized components, such as switching elements, diaphragm systems and pressure ports. See How to Order on page 4. Consult the factory or the SOR representative in your area for more assistance.



Weatherproof

General purpose, weathertight and conventional explosion proof models are presented in this catalog. Refer to catalog Forms 388 and 468 for models with hermetically sealed switching element capsules for use in hazardous locations and extremely harsh environments, or when system (static) pressure varies significantly.

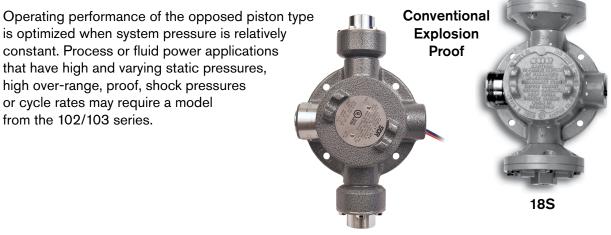

15, 17S

Design and specifications are subject to change without notice. For latest revision, see SORInc.com.

Complete Product Line

• Standard models with many options cover pressure range 0.5 to 1000 psid. Customized specials available.

Robust Construction

• Rugged, high-cycle rate tolerance, long life, not critical to vibration, high overrange and proof pressures, excellent corrosion resistance to hostile environments.

Instrument Quality

• High repeatability, narrow dead band, negligible temperature effect.

Wetted Parts

• Wide selection of materials, process connections configuration and size.

Snap-Action Electrical Switching Element

• Wide selection UL Listed and CSA Certified switching elements for AC and DC service.

Field Adjustable

• Excellent resolution of Set Points, selflocking adjustment, no special tools required. No charge for factory calibration.

Agency Listings/Certification

- Select models with ATEX, IECEx, CSA and INMETRO.
- Meets most code and customer requirements.

Safety Certified to IEC 61508 (SIL)

 SOR products are certified to IEC 61508 for non-redundant use in SIL1 and SIL2 Safety Instrumented Systems for most models. For more details or values applicable to a specific product, see the Safety Integrity Level Quick Guide (Form 1528).

Delivery

- Routine shipments 7 to 10 working days.
- Emergency shipments via air same day.

Service

 Factory service engineers and area factory representatives provide effective and prompt worldwide service.


Warranty

• 3 years from date of manufacture.

Principles of Operation

Basic construction is opposing Static "O" Ring diaphragm sealed pistons connected by a common shaft. Hi side system pressure acts on Piston A to produce Force Fh. It is counteracted by adjustable range spring Force Fs. Lo side system pressure acts on Piston B to produce Force Fl. The resultant force corresponds to the difference in pressure between the Hi and Lo system pressure plus the force of the adjustable range spring and moves the trip lever to actuate and deactuate the SPDT electrical switching element.

There are only three wetted parts on the Hi and Lo process connections: pressure port, diaphragm and o-ring. A metal diaphragm may be welded to the pressure port for certain applications, thereby eliminating the o-ring.

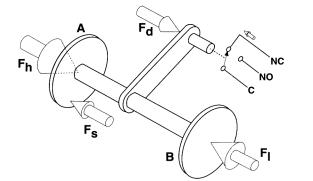

A = Hi Pressure Piston
B = Lo Pressure Piston
Fh = Force, Hi Pressure
FI = Force, Lo Pressure
Fs = Force, Range Spring
Fd = Force Resultant Differential (Hi-Lo)

- Use this Quick Selection Guide for basic opposed piston differential pressure switches with standard wetted parts that are normally suitable for air, oil, water and non-corrosive processes.
- For systems with other varied pressures or corrosive processes refer to How to Order model tree on page 3 to configure a model that fits your specific application.

Weathertight Model Number	Adjustable Range (increasing differential pressure) psid	Typical Dead Band psi	Explosion Proof Model Number
18RB-K2-N4-B1A	0.5 to 2.0	0.15	18S-K2-N4-B1A
18RB-K5-N4-B1A	0.5 to 12.0	0.2	18S-K5-N4-B1A
15RB-K2-N4-B1A	2.5 to 8.0	0.6	15S-K2-N4-B1A
15RB-K5-N4-B1A	3 to 50	0.6	15S-K5-N4-B1A
17RB-K2-N4-B1A	4 to 15	1.2	17S-K2-N4-B1A
17RB-K3-N4-B1A	5 to 60	1.0	17S-K3-N4-B1A
17RB-K5-N4-B1A	5 to 100	1.5	17S-K5-N4-B1A
14RB-K2-N4-F1A	8 to 30	2.5	14S-K2-N4-F1A
14RB-K5-N4-F1A	15 to 150	2.5	14S-K5-N4-F1A
13RB-K2-N4-F1A	15 to 60	5.0	13S-K2-N4-F1A
13RB-K5-N4-F1A	35 to 375	6.0	13S-K5-N4-F1A
16RB-K2-N4-F1A	60 to 150	20	16S-K2-N4-F1A
16RB-K5-N4-F1A	100 to 1000	20	16S-K5-N4-F1A
Piston Number 18 15 17 14,13 16	Maximum Sys 20 125 500 1000 2000	Proof Pressure 400 psi 1000 psi 1000 psi 2500 psi 2500 psi	


Standard Construction

- 1. Housing: RB aluminum, S cast iron. See housing and dimensions page for optional housings.
- 2. Switching Element: K SPDT 15 amp @ 250 VAC. See Switching Element page for optional switching elements.
- 3. Diaphragm & o-ring: N4 primary diaphragm (wetted) TCP, o-ring (wetted) Buna-N. See diaphragm & o-ring page for optional diaphragm and o-ring systems.
- 4. Pressure Port: B1A aluminum 1/4" NPT(F); F1A carbon steel 1/4" NPT(F). See pressure port page for optional pressure ports.

How to Order

Below is the SOR model number tree that provides you with all the options to configure and order a product for your specific application.

- You must select a designator for each component except for Accessories.
- Reference tables, charts and additional information is provided throughout the catalog to help you make your selections. See pages noted in the tree.

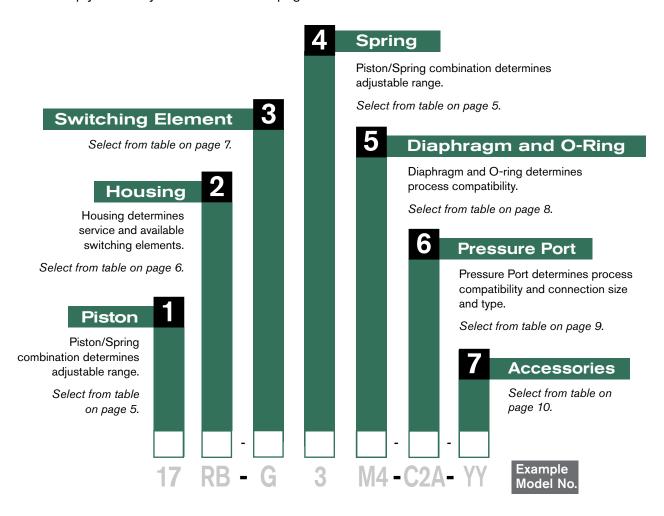

Order information must include:

- 1. If agency approved, certified or listed pressure switches are required, see page 11 for components that must be specified.
- 2. Set Point (increasing or decreasing)
- 3. If decreasing Set Point, state from what greater Set Point is approached.
- 4. If DPDT (2-SPDT), state whether simultaneous actuation or deactuation (Set Points) should occur at increasing or decreasing.
- 5. Simultaneous actuation or deactuation (Set Points) can occur at either increasing or decreasing, but not both.

If Agency Approved, Certified or Listed pressure switches are required, see page 11 for components that must be specified.

Step 1 & 4: Piston/Spring

17RB-G3-M4-C2A-YY

The Opposed Piston differential pressure switch is generally suited for a variety of process applications ranging from simple air and water to highly corrosive, viscous or slurry service. Its performance is optomized when system (static) pressure is relatively constant. Consult the factory if system (static) pressure varies more than $\pm 20\%$ of normal. Easily customized with a wide selection of optional components.

Piston	Adjustable Range			Typical D	ead Band	Maxir Syst Pres	tem	Proof Pressure		
а	S	psid	bar (mbar)	psi	bar (mbar)	psi	bar	psi	bar	
18	2	0.5 to 2.0	(35 to 140)	0.15	(10)	20	1.5	400	30	
18	5	0.5 to 12.0	(35 to 830)	0.2	(15)	20	1.0	400	30	
15	2	2.5 to 8.0	(170 to 550)	0.6	(40)	105	9			
15	5	3 to 50	0.2 to 3.5	0.6	(40)	125	9		70	
17	2	4 to 15	0.3 to 1.0	1.2	(80)		34	1000		
17	3	5 to 60	0.3 to 4.0	1.0	(70)	500				
17	5	5 to 100	0.3 to 7.0	1.5	(100)					
14	2	8 to 30	0.6 to 2.0	2.5	(170)					
14	5	15 to 150	1.0 to 10	2.5	(170)	1000	70			
13	2	15 to 60	1.0 to 4.0	5.0	0.3	1000	70	05.00	170	
13	5	35 to 375	2.4 to 26	6.0	0.4			2500	170	
16	2	60 to 150	4.0 to 10	20	1.4	2000	140			
16	2	100 to 1000	7.0 to 70	20	1.4	2000	140			

Notes


- Dead band values are expressed as typical expected at mid-adjustable range and 50% maximum system pressure (static pressure) using the standard K switching element. When an optional switching element is specified, its corresponding dead band multiplier (pages 6 and 7) must be applied to the typical dead band value shown for piston-spring combination in specifications above.
- 2. Check restrictions on page 7 for optional electrical switching elements and page 8 for optional diaphragm systems.
- 3. H, J, W, U, N6 and N3 diaphragm systems may widen dead band. Consult factory.

- 4. Metric bar (mbar) values are practical equivalents of the reference English values; not necessarily exact mathematical conversions. This data appears on the product nameplate when metric engineering units are specified.
- 5. Ranges with spring designator 2 can only be used with switching elements K, KA, W, E, J or Y if diaphragm H, J, U, W or N3 is also specified.
- 6. Selection of microswitch with large dead band multiplier may effect lower range of unit.

Design and specifications are subject to change without notice.

Step 2: Housing 17**RB**-G3-M4-C2A-YY

Weathertight NEMA 4, 4X, IP66

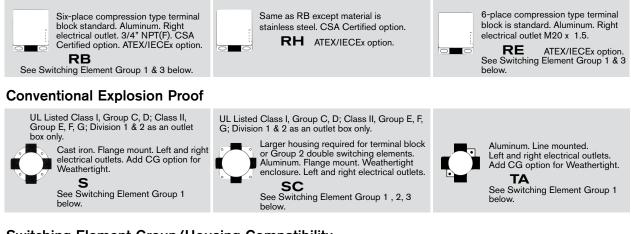

Switching Element Group/Housing Compatibility

 Group 1
 Group 2
 Group 3

 A, B, E, G, J, K, KA, L, W, Y
 GG, KK, YY*
 AA, BB, EE, JJ**

Notes

- *1. Terminal block is not available with switching elements from Group 2. (See TB option.)
- **2. Switching Elements AA, BB, EE, and JJ are not available in the S and TA housings.

Dead Band Considerations

- Dead band values are expressed as typical expected at mid-adjustable range and 50% maximum system pressure (static pressure) using the standard K switching element.
- 2. Dead band is fixed (nonadjustable).
- When an optional switching element is specified, its corresponding dead band multiplier must be applied to the typical dead band value shown for piston-spring combination on specifications, page 5.
- 4. Dead band can be widened by selecting an optional switching element with a dead band multiplier greater than 1.0.

Example: Model 17RB-AA3-M4-C2A-YY

Typical standard dead band: 1.0 AA switching element multiplier: 4 Corrected typical dead band: 4 x 1.0 psi = 4 psi 5. Dead band multipliers increase when system operating pressure exceeds 60% of maximum system pressure listed in the specifications table on page 5.

Example: For Model 14RB-AA5-N4-F1A, the dead band multiplier may be larger than 4.0 if the maximum system pressure exceeds 600 psi.

Switching Element Designators	Dead Band Multipliers				
K, KA, W	1.0				
E, J	1.5				
KK, Y	2.0				
A, B, G, YY	3.0				
EE, JJ	3.5				
AA, BB, GG	4.0 Note 5				
L	5.0 Note 5				

Step 3: Switching Element

17RB-**G**3-M4-C2A-YY

Switching Element Service	Electrical Contact	Electrical Connection	AC Rating		DC Rating Resistive			tive		Band iplier	Designator	
Service	Туре	Туре	Volts	Amps	Volts	Amps	Volts	Amps	SPDT	DPDT	SPDT	DPDT
Normal Service AC	SPDT		250	15	125	.4*	30	5*	1.0	2.0	K	KK
Low Power	$\sim \sim$	ø	125	1	-	-	28	1*	1.0	-	KA	N/A
Gold Contacts	ĽĽ, s	Leads re	125	1	-	-	30	1	1.5	3.5	J	JJ
Wide Dead Band AC	SP sin atic		250	15	125	.5	-	-	3.0	4.0	G	GG
AC or DC	Element: Element arsly actu ars. * nts. * Noded W nal block	250	11	125	.5*	30	5.0	3.0	4.0	А	AA	
Wide Dead Band DC	ng Element ing Elemen neously acti either incre points.	Code	250	15	-	-	30	10*	5.0	-	L	N/A
Narrow Dead Band DC	Switching Elem Switching Elem Simultaneously ation at either in sing set points.	Color-Coded Wire en terminal blocks a	250	5	125	.5*	30	5.0*	1.5	3.5	E	EE
Hi Ambient	Switching Switching Simultane ation at ei sing set p	hen C	250	5	125	.3	-	-	3.0	4.0	В	BB
Temperature	gle S ble S DT Si ctuat	Double Switching Element: L SPDT Simultaneously actuat deactuation at either increasi decreasing set points. * 18" AWG Color-Coded Wir except when terminal blocks specified.	250	5	125	.5*	-	-	2.0	3.0	Y	YY
Rating - 400°F	Single S Double SPDT S deactua decreas	18" exce spec	250	5	125	.3*	-	-	1.0	-	W	N/A

Notes

- 1. Only conventional switching elements are shown. Refer to Forms 388 and 468, the SOR representative in your area, or the factory for information about hermetically sealed switch capsule.
- 2. All switching elements have wire leads except when supplied in RB, RE and RH housings. Terminal block is standard in RB, RE and RH housings.
- Dead band multipliers must be applied to typical dead band figures given in the specification tables on pages 4 and 5. See dead band considerations on page 6.
- 4. Maximum Ambient Temperature Limits:
 - -65 to 400°F
 (-54 to 204°C)
 B, Y, W

 -65 to 250°F
 (-54 to 120°C)
 A, E & J

 -65 to 180°F
 (-54 to 80°C)
 All others

 Consult factory for temperatures below -40°F.
- Switching Elements W and Y have an Elgiloy spring.

- Certain switching elements can handle greater voltage. Consult the factory should your requirements exceed catalog values. All switching elements above are UL Listed and CSA Certified. The DC current ratings marked with an asterisk (*) are not UL Listed but have been verified by testing and/or experience.
- 7. Cross reference compatibility chart on page 6 to ensure that switching element will fit in housing.
- Ranges with spring designator 2 can only be used with switching elements K, KA, W, E, J or Y if diaphragm series H, J, U, W or N3 is also specified.
- 9. Selection of microswitch with large dead band multiplier may effect lower range of unit.

CAUTION: Switching element assembly has been precisely positioned in the housing at the factory for optimum performance. Any inadvertent movement or replacement in the field will degrade performance and could render the device inoperative, unless authorized procedures are followed.

*DPDT: Double-pole, double-throw contact can be factory synchronized to actuate together on increasing differential Set Point or to deactuate together on decreasing differential Set Point. Specify on order whether contacts should be synchronized on increasing or decreasing Set Point.

Step 4: Diaphragm & O-Ring

17RB-G3-**M4**-C2A-YY

Notes

- 1. N4 diaphragm system is standard, but requires designator in the model number. It is normally suitable for air, oil, water and noncorrosive processes.
- If Kalrez, EPR or Viton is selected for high temperature process media or ambient temperature requirements, the A, B, E, J, W or Y switching elements are suggested with reference to the table in Note 4, page 7.
- 3. Other diaphragm and o-ring combinations may be available. Consult the factory or the SOR representative in your area for more information.
- 4. Wetted parts have been selected as representing the most suitable commercially available material for use in the service intended. However, they do not constitute a guarantee against corrosion or permeation, since processes vary from plant to plant and concentration of harmful fluids, gases or solids vary from time to time in a given process. Empirical experience by users should be the final guide. Alternate materials based on this are generally available.
- 6. Specify N3 diaphragm system for high cycle rate, high shock applications where Buna-N and TCP are compatible with the process.
- Each o-ring works best in certain temperature ranges. This table shows allowable minimum and maximum temperatures for o-rings. Consult the factory for temperatures down to -65°F on welded metal diaphragm systems.

O-Ring Material	°F	°C
Viton	32 to 400	0 to 204
Viton GLT	-20 to 400	-29 to 204
Kalrez	0 to 400	-18 to 204
Aflas	25 to 400	-4 to 204
Buna-N Neoprene EPR	-30 to 200	-34 to 93
Welded Diaphragm System	-30 to 400	-34 to 204
TCP-Teflon Coated Polyimide Diaphragm	-30 to 400	-34 to 204

- 8. Dead bands are slightly higher when using H, J, W, U or N3 series diaphragm options. Consult the factory.
- 9. M9 diaphragm system is suitable for steam applications up to 400°F.
- Ranges with Spring Designator 2 can only be used with switching elements K, KA, W, E, J or Y if Diaphragm H, J, U, W or N3 is also specified.

O-Ring	Diaphragm					
(Wetted)	(Wetted Primary)	Designator				
Viton	Monel	A4				
Kalrez	Wioffici	A6				
Viton	Hastelloy B	H4				
Kalrez	(See Note 10)	H6				
Viton	Hastelloy C	J4				
Kalrez	(See Note 10)	J6				
Viton	Carpenter 20	L4				
Kalrez	Carpenter 20	L6				
Viton GLT		M1				
Buna - N		M2				
Viton		M4				
Neoprene	316L SS	M5				
Kalrez		M7				
Aflas		M8				
EPR		M9 (See Note 9)				
Viton		N1				
Buna - N	TCP Teflon - Coated	N3 (See Note 6 and 10)				
Buna - N	Polyimide	N4 Standard (see Note 1)				
Kalrez		N5				
Kalrez	Kalrez	N6				
EPR	TCP Teflon - Coated	N7				
Aflas	Polyimide	N8				
Buna - N	Buna - N	P1				
Neoprene	Neoprene	R1				
Viton	Viton	S1				
Viton GLT	VILON	S2				
Buna - N		W2				
Viton	Tantalum	W4				
Neoprene	(See Note 10)	W5				
Kalrez		W6				
EPR Ethylene Propylene	EPR Ethylene Propylene	Y1				
None	Welded (See Note 10)	U9				

Step 5: Pressure Port

17RB-G3-M4-**C2A**-YY

	Piston	18, 15, 17	14, 13, 16	18, 15, 17	14, 13, 16	14, 13, 16	15, 17	18	18			
C	Process Connection Size	1/4" NPT(F)		1/2" NPT(F)		3/4" NPT(M)	1" NPT(M)	1" NPT(F)	2" NPT(F)			
	Aluminum Series 2000 Wrought 356 or 360 Casting	B1A (Standard)	N/A	B2A	N/A	N/A	N/A	N/A	N/A			
le	Carbon Steel Ledloy AX Wrought WCB Casting	N/A	F1A (Standard)	N/A	F2A	F3A	N/A	N/A	N/A			
Pressure Port Material	316 Stainless Steel Wrought CF-8M Casting	C	C1A		2A	СЗА	C4A	C5A	C6A			
essure Pc	347 Stainless Steel Wrought CF-8C Casting	E1A		E2A	E2A	E3A						
Pre	Carpenter 20 Stainless Steel Wrought CF-7M Casting	L1A		L2A L2A		L3A	Cons	ry for				
	Brass (See note 6) Half Hard Yellow Wrought Silicon Brass Casting	D	D1A		D2A		Port	availability of Pressure Port Material and Connection Size.				
	Hastelloy B	H	H1A		H2A	НЗА						
	Hastelloy C	J1	J1A		J2A	J3A						
	Monel	A	IA	A2A	A2A	АЗА						

Notes

- Select designator for material and connection size. Large bold face designators denote those items generally available from stock. Small light face designators denote items with limited stock and possible long delivery.
- 2. 1/4" and 1/2" tapered BSP(F) pressure ports are available. Consult the factory.
- 3. The standard material of Number 15, 17 and 18 Series pressure ports is cast aluminum.
- 4. The standard material of Number 13, 14 and 16 Series pressure ports is carbon steel wrought.
- 5. Other materials such as PVC, Kynar, etc., are available.

Denote unlisted material by specifying an X followed by the required connection size, and describe the material.

Examples:

X2A = PVC pressure port with 1/2" NPT(F) connection. X1A = Titanium pressure port with 1/4" NPT(F) connection.

Nonmetal pressure ports generally reduce proof pressure and may reduce overrange pressure. The pressure port material may limit the process temperature. Delivery may be longer than normal.

6. Brass not available on Piston Number 16.

Step 6: Accessories

17RB-G3-M4-C2A-YY

Description		Designator					
Wetted parts are c	leaned for oxygen service.	BB					
Neoprene cover ga	sket (o-ring) to make S and TA explosion-proof housing weathertight.	CG					
ATEX/IECEx appro	ved differential pressure switch. See Agency Listings on page 11 for details.	CL					
CSA Certified Switch	n. Available with RB, RH. Housing has earth (ground) lug. See Agency Listing on page 11 for details.	CS					
Sealed electrical lead adapter. Provides protection to housing interior, switching element and dry side of pressure sensing assembly from condensate in the electrical conduit and corrosive atmospheres. (Protrudes approximately 2" from housing.)							
Breather Drain	Course Hinds ECD-15 for Hazardous Locations Class I, Groups C & D; Class II, Groups E, F, and G; on S or SC housings only.	кк					
	Sintered metal plug in weathertight housing.						
er than 10 in. Hg. If	late retains diaphragm system in the pressure switch if subjected to intermittent vacuum great- a pressure switch is subjected to continuous, rapid changes of vacuum, other protection may t factory). Material matches or exceeds pressure port material. N/A on pistons 52, 54, or 56.	ММ					
INMETRO approve	ed pressure switch. See Agency Listings on page 11 for details.	NM					
Carbon steel body	with stainless steel adjusting nut.	PB					
Pipe (stanchion) mounting kit for (1-1/2 to 2" pipe).							
Tag, fiber. Attached	with plastic wire to housing. Stamped with customer specified tagging information.	PP					
Powder coat epoxy	coating. No coating on stainless steel parts or plated screws. (500 hours-salt spray)	PY					
	Attached with stainless steel wire to housing. Stamped with customer specified tagging s, 18 characters and spaces per line.)	RR					
conduit connections	weathertight electrical junction box with screw terminals. Aluminum 3/4" NPT(F) top or right as required. UL Listed/CSA Certified Class I, Groups A, B, C & D; Class II, Group E, F, & G; lable on S, SC & TA Housing.) Includes cover o-ring for weathertight applications.	TB*					
Taiwan Safety Mark	x. Requires use of CL option.	TS					
	steel nameplate or separate stainless steel tag. Permanently attached to housing. Stamped cified tagging information.	тт					
Fungicidal varnish. Covers exterior and interior except working parts.							
Epoxy coating. Exterior only. Polyimide epoxy with 316SS pigment. (200 hours-salt spray)							
Chained cover with captive screws to conform to former JIC specification.							
"X" is used as a suffix to the Model Number for special requirements not keyed elsewhere in the model number by an "X". Each "X" must be completely identified in the text of the order or inquiry. When more than one "X" is required, use "X" followed by the number of such items. For example, "X3" means three separate otherwise unidentifiable requirements							

* Agency ratings for SOR product sold with junction boxes will be limited to either the rating of the instrument housing or junction box, whichever is lower.

Note: See page 11 for Agency Approved, Certified or Listed Accessories/Options.

Certificates	D1	D2	C1	C2	C3	C4	C5	C6	C8	B1	B4	B5	B6	B7	A1	A2	A3	A4	A5	A6	A7	A8
Calibration			•							•	•	•	•	•	•	•	•	•	•	•	•	•
Hydrostatic Pressure Test				•						•	•					•	•	•	•	•	•	•
Inspection Report					•					•	•	•	•	•			•	•		•	•	•
Compliance /Conformance						٠								٠	٠	•		•	•			•
Dielectric Test							•				•	•									•	
Insulation Resistance								•			•	•	•							•	•	•
Typical Material of Wetted Parts									•	•	•				•				•	•		
Certificate of Origin	٠																					
Manufacturer's Certification		•																				

The following combinations only are available as approved, certified or listed by the agencies shown. Some components are for products not offered in this catalog. Certain components or combinations may acquire additional approval, certification or listing between print dates of this catalog. Contact the factory for the most current information.

CSA Enclosure 4 (Weatherproof)

	Piston	Housing	Switching Element	Spring	Diaphragm & O-Ring	Pressure Port Material and Connection Size	Accessories/ Options
	13, 14, 15, 16, 17, 18	RB, RH	A, AA, B, BB, C, E, EE, G, J, JJ, K, KA, L, S, W, Y	All	All	All	CS Required All except KK, LL, TS, ZZ
ATEX/IECE or	x Exial	IC T6T4 G	þ				
INMETRO	A1 1	RB, RH,		All	All	All	CL Required for ATEX/IECEx
	ALL	RE	נו ,ו	All			NM Required for INMETRO

Glossary of Terms

SOR recognizes that there is no industry convention with respect to terminology and definitions pertinent to pressure switches. This glossary applies to SOR Opposed Piston Differential Pressure Switches.

Adjustable Range

The span of differential pressure between upper and lower limits within which the pressure switch can be adjusted to actuate/deactuate. It is expressed for increasing differential pressure.

Set Point

That discrete differential pressure at which the pressure switch is adjusted to actuate/deactuate on rising or falling differential pressure. It must fall within the adjustable range and be called out as increasing or decreasing pressure.

Dead Band

The difference in pressure between the increasing Set Point and the decreasing Set Point. It is expressed as typical, which is an average with the increasing Set Point at mid adjustable range and 50% of maximum system pressure (static pressure) for a differential pressure system with the standard K switching element. It is normally fixed (nonadjustable).

Overrange

The maximum input pressure that can be continuously applied to the differential pressure switch without causing permanent change of Set Point, leakage or material failure.

Proof Pressure

The maximum input pressure that can be continuously applied to the pressure switch without causing leakage or catastrophic material failure. Permanent change of Set Points may occur, or the device may be rendered inoperative.

Repeatability

The ability of a differential pressure switch to successively operate at a Set Point that is approached from a starting point in the same direction and returns to the starting point over three consecutive cycles to establish a pressure profile. The closeness of the measured Set Point values is normally expressed as a percentage of full scale (maximum adjustable range differential pressure). **Note:** Values for repeatability are not shown in this catalog because it is necessary to know the pressure profile of a particular application.

Actual shipping weights may vary from the charted values because of product material, configuration and packaging requirements.

Components	Designator	Weight (lbs)	Weight (kgs)	Components	Designator	Weight (lbs)	Weight (kgs)
Housing	RB, RE	3	1.5	Housing	S	6	3.0
Housing	RH	6	3.0	Housing	TA	7	3.5
Housing	SC	5	2.5	Junction Box	ТВ	5	2.25
				Pipe Mounting Kit	PK	1.5	0.7

Dimensions


Dimensions in this catalog are for reference only. They may be changed without notice. Contact the factory for certified drawings for a particular model number.

Process Connection Size		Piston Number	
Process Connection Size	18	15, 17	13, 14, 16
1/4" NPT(F)	Shown	Shown	Shown
1/2" NPT(F)	Shown	Shown	Add <u>13.2</u> 0.52
3/4" NPT(M)	N/A	N/A	Add <u>23.1</u> 0.91
1" NPT(F)	Add <u>5.6</u> 0.22	N/A	N/A
1" NPT(M)	N/A	Add <u>46.0</u> 1.81	N/A
2" NPT(F)	Add <u>25.4</u> 1.00	N/A	N/A
Length "A" 1/4" NPT(M)	Add <u>29.7</u> 1.17	Add <u>29.7</u> 1.17	Add <u>29.7</u> 1.17
Length "A 1/2" NPT(M)	Add <u>38.9</u> 1.53	Add <u>38.9</u> 1.53	Add <u>38.9</u> 1.53

Notes


- 1. Dimensions on pages 13 19 are expressed as millimeters over inches (Linear = mm/in.).
- 2. Dimensions marked with an asterisk (*) on housing dimension drawings vary with respect to process connection size. The chart above lists these dimensional variances.

Dimensions in this catalog are for reference only. They may be changed without notice. Contact the factory for certified drawings for a particular model number.

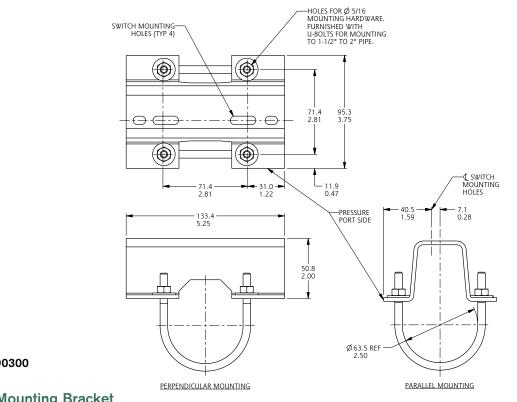

Drawing 0090300


PK: Pipe Mounting Bracket

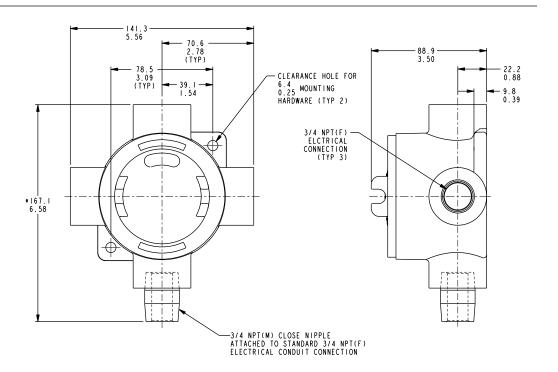

Drawing 0091353 • DIMENSION SHOWN IS APPROXIMATE AND BASED ON A 5-THREAD ENGAGEMENT. TB: Junction Box with Terminal Block


Dimensions in this catalog are for reference only. They may be changed without notice. Contact the factory for certified drawings for a particular model number.

Weathertight-NEMA 4, 4X, IP65

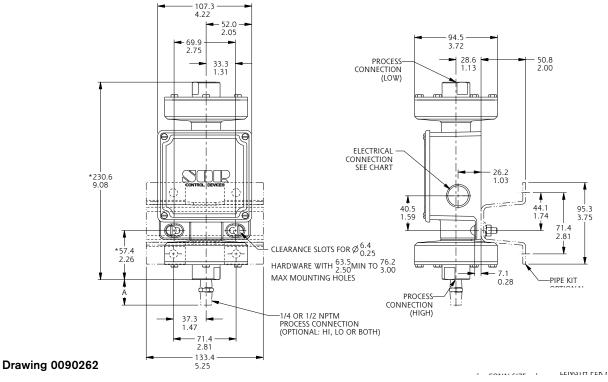

Designator: RB, RH, RE: Piston Number 18

Conventional Explosion Proof

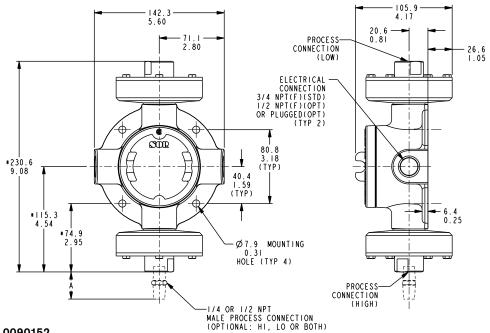


Drawing 0090152

Designator: S: Piston Number 18


Dimensions in this catalog are for reference only. They may be changed without notice. Contact the factory for certified drawings for a particular model number.

Weathertight-NEMA 4, 4X, IP65

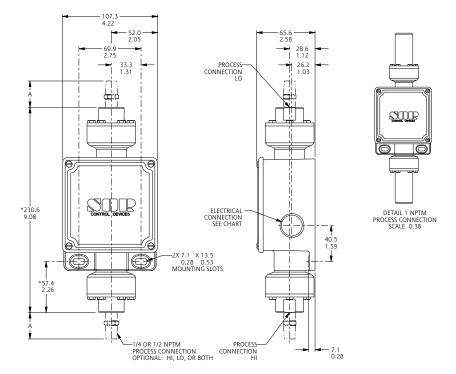

Drawing 0090265


Designator: RB, RH, RE: Piston Number 15, 17

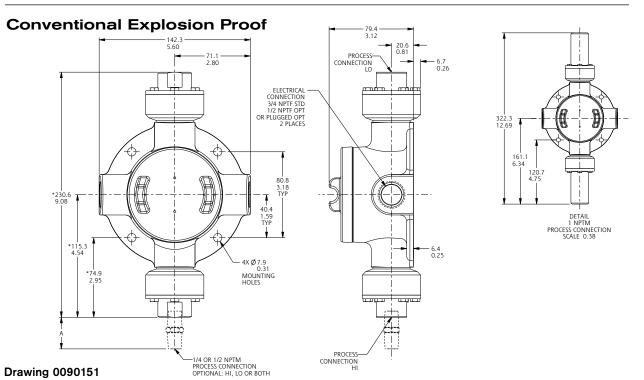

Designator: S: Piston Number 15, 17

Dimensions in this catalog are for reference only. They may be changed without notice. Contact the factory for certified drawings for a particular model number.


Weathertight-NEMA 4, 4X, IP65

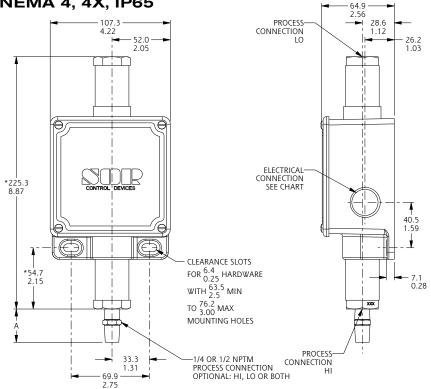

Drawing 0090263

Designator: RB, RH, RE: Piston Number 13, 14, 16


Conventional Explosion Proof

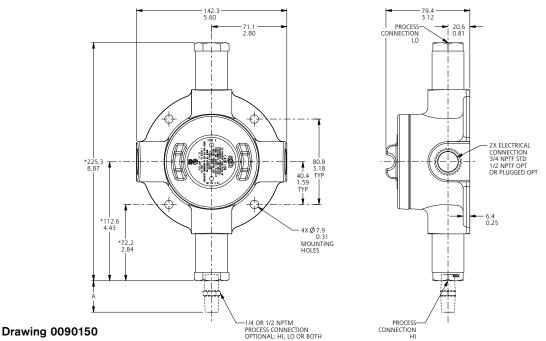

Designator: S: Piston Number 13, 14, 16


Dimensions in this catalog are for reference only. They may be changed without notice. Contact the factory for certified drawings for a particular model number.

Conventional Explosion Proof

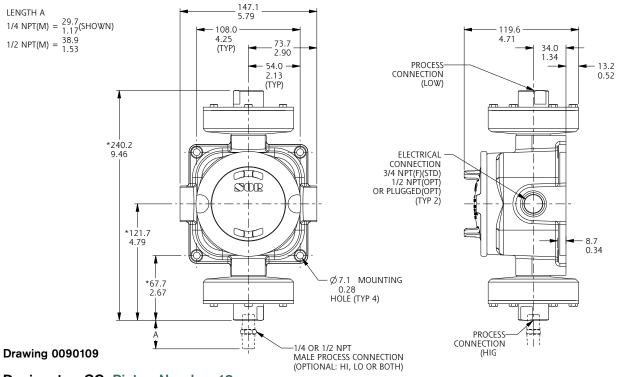

Designator: SC: Piston Number 18

Conventional Explosion Proof

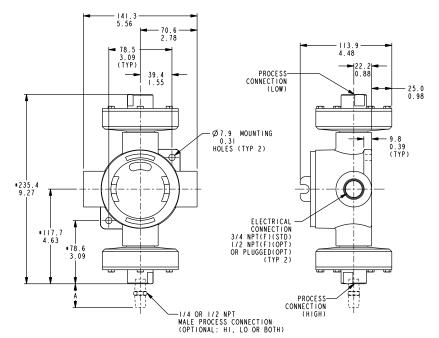


Drawing 0090248

Designator: TA: Piston Number 18


Dimensions in this catalog are for reference only. They may be changed without notice. Contact the factory for certified drawings for a particular model number.

Conventional Explosion Proof

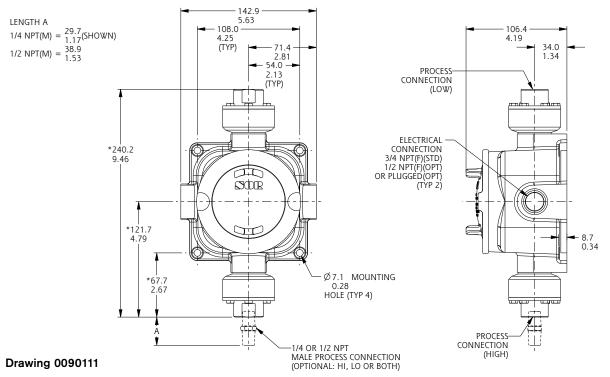

Designator: SC: Piston Number 15, 17

Conventional Explosion Proof

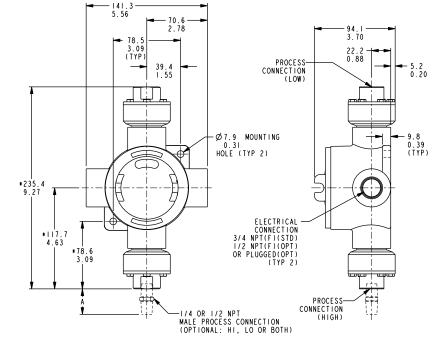


Drawing 0090157

Designator: TA: Piston Number 15, 17


Dimensions in this catalog are for reference only. They may be changed without notice. Contact the factory for certified drawings for a particular model number.

Conventional Explosion Proof

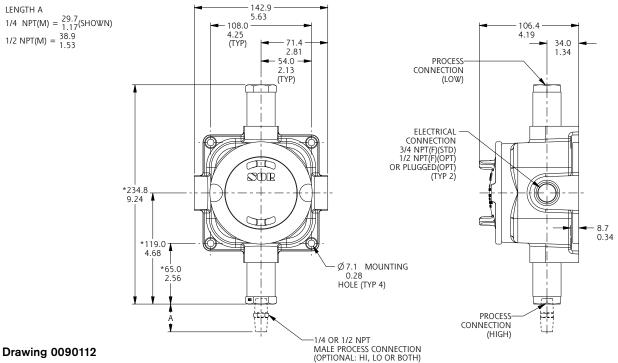

Designator: SC: Piston Number 13, 14, 16

Conventional Explosion Proof

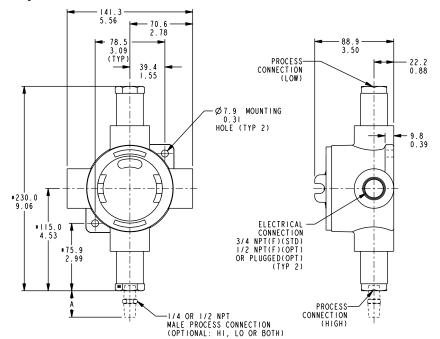

Drawing 0090156

Designator: TA: Piston Number 13, 14, 16



MEASUREMENT AND CONTROL

Lenexa, KS USA 913-888-2630 Fax 913-888-0767 SORInc.com

REGIONAL OFFICES

China

SOR China | Beijing, China | china@SORInc.com +86 10 5820 8767 | Fax +86 10 5820 8770

Middle East

SOR Measurement & Control Equipment Trading DMCC Dubai, UAE middleeast@SORInc.com +971 4 278 9632 Fax +1 913 312 3596

Form 386 (09.23) ©SOR Inc.